

662 Cromwell Avenue, St. Paul, MN 55114-1776
 (651) 645-3601, Fax: (651) 659-7348

TO:  **BAXIM®**
 FIBRILLATED CONCRETE FIBER - BAXI-FIBER P200

DATE: July 10, 2002

PROJECT NO: 032059

**PROJECT: PERFORMANCE EVALUATION – AVERAGE RESIDUAL STRENGTH
 CONCRETE WITH SYNTHETIC FIBERS – FIBRILLATED FIBERS**

TESTING OF CONCRETE WITH SYNTHETIC FIBERS

INTRODUCTION:

This report presents the results of our laboratory testing of concrete with P200 Fibrillated Fibers (4 lbs/yd³ dosage rate).

The scope of our testing was as follows:

1. Perform laboratory concrete trial batching of concrete with P200 Fibrillated Fibers according to ASTM:C1399 for the determination of the Average Residual Strength (ARS).
2. Prepare a written report outlining our test results.

The following test program was conducted in accordance with Miami Dada County Test notification Number TCTCMN02003.

SUMMARY OF TEST RESULTS:

The following is a summary of the test results:

<u>Test</u>	P200 Fibrillated Fibers
Average Residual Strength, MPa (psi)	0.94 (136)

¹The results are the average of three samples.

TEST PROCEDURES:

The testing was initiated on May 14, 2002 and subsequent dates using applicable portions of ASTM:C1399-98, "Test Method for Obtaining Average Residual-Strength for Fiber Reinforced Concrete". The concrete test mixture was derived using the procedures outlined in ASTM:C494 Sections 11-15. The mix design used is included in the Concrete Materials section of this report along with the other pertinent information. Additional ASTM procedures were also used in conjunction with this test program.

SYNTHETIC FIBER DATA:

Synthetic Fibers - P200 Fibrillated Fibers
 Date Submitted – February 21, 2002
 Application/mixing - Min. 4 minutes

TESTING OF CONCRETE WITH SYNTHETIC FIBERS

CONCRETE MATERIALS:

Concrete Trial Mixtures

Mix Number	1
Mixture Type	Fiber
Cementitious Content ¹ , kg (lbs)	234.5 (517)
Slump, mm (in.)	50.8-76.2 (2-3)
Nominal Coarse Aggregate, mm (in.)	19.2 (3/4)
Air Content, %	n/a
Specified Minimum	
Compressive Strength, MPa (psi)	27.6 (4,000)

¹Type I Cement and Type C Flyash

Materials

Cementitious Materials	Lehigh Type I Portland Cement (ASTM:C150) Mineral Solutions Type C Flyash (ASTM:C618)
Fine Aggregate	Shiely Aggregates Inc. (Natural Sand Meeting the Requirements of ASTM:C33 and C494)
Coarse Aggregate	Shiely Aggregates Inc. (Limestone Size Number 57 Meeting the Requirements of ASTM:C33 and C494)
Admixtures	P200 Fibrillated Fibers

Batch Weights

Mix Number	1
Mixture Type	Fiber
Portland Cement, kg (lbs)	199.1 (439)
Type C Flyash, kg (lbs)	35.4 (78)
Admixture:	
P200 Fibrillated Fibers, kg (lbs)	1.81 (4.0)
Fine Aggregate, kg (lbs)	648.6 (1,430)
Total Coarse Agg., kg (lbs)	778.8 (1,717)
Water, kg (lbs)	131.5 (290)

Mix numbers 1 was used in casting of the ARS samples.

TESTING OF CONCRETE WITH SYNTHETIC FIBERS**TEST RESULTS:****Concrete Test Data**

Mix Number	1
Mixture Type	Fiber
Slump, mm (in.)	76.2 (3)
Air Content, (%)	2.0
Unit Weight, Kg/m ³ (lbs/ft ³)	2,332.0 (145.6)
14-Day Compressive Strength, Mpa (psi)	26.4 (3,830)


All of the samples were cast into beam molds. The samples were moist cured for 13 days and tested at 14 days from casting.

Average Residual Strength – ASTM:C1399

Please see the attached data sheet.

REMARKS:

The samples were discarded at the completion of testing. If you have any questions about this report, please feel free to contact us at (651) 659-7340.

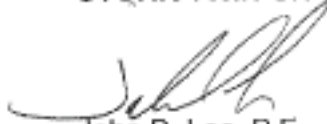STORK TWIN CITY TESTING CORPORATION

John D. Lee, P.E.
Senior Staff Engineer
Construction Materials Department
C:\My Documents\032059\4.0 Fibreport.doc

AVERAGE RESIDUAL STRENGTH - ASTM:C1399

Standard Values


Sample Number	Sample Width, in.	Sample Depth, in.	Test Span, in.	Load in at Deflection, lbs.				Failure Load, lbs	Failure Load, psi	ARS, psi
				0.02 in.	0.03 in.	0.04 in.	0.05 in.			
1A	4.01	4.00	12.00	792.3	765.0	724.5	672.0	4385.5	820	136
1B	4.01	4.00	12.00	783.0	765.3	721.4	649.1	3820.0	714	137
1C	4.00	4.01	12.00	822.8	750.1	665.8	593.7	3709.2	692	132
Average	4.01	4.00	12.00	799.4	766.8	703.9	638.3	3971.6	742	136

Metric Values

Sample Number	Sample Width, mm	Sample Depth, mm	Test Span, mm	Load in at Deflection, N				Failure Load, N	Failure Load, MPa	ARS, MPa
				0.02 in.	0.03 in.	0.04 in.	0.05 in.			
1A	101.9	101.6	304.8	3524.3	3402.9	3222.7	2989.2	19507.6	5.63	0.95
1B	101.9	101.6	304.8	3462.9	3493.2	3208.9	2887.3	16992.1	4.90	0.95
1C	101.6	101.9	304.8	3660.0	3336.6	2961.6	2640.9	16499.3	4.80	0.91
Average	101.8	101.7	304.8	3555.7	3410.9	3131.1	2839.1	17666.3	5.11	0.94

TCT Project Number: 032059
Date: 7/10/02
Fiber Type: P200 Fibrillated Fibers
Fiber Dosage Rate: 4 lbs/yd
Concrete Strength: 3830 psi @ 14 Days
Concrete Slump: 3 inches
Concrete Air Content: 2.0%
Concrete Unit Weight: 145.6 lbs/yd


662 Cromwell Avenue • St. Paul, MN 55114-1776
(651) 645-3601 • Fax: (651) 659-7348

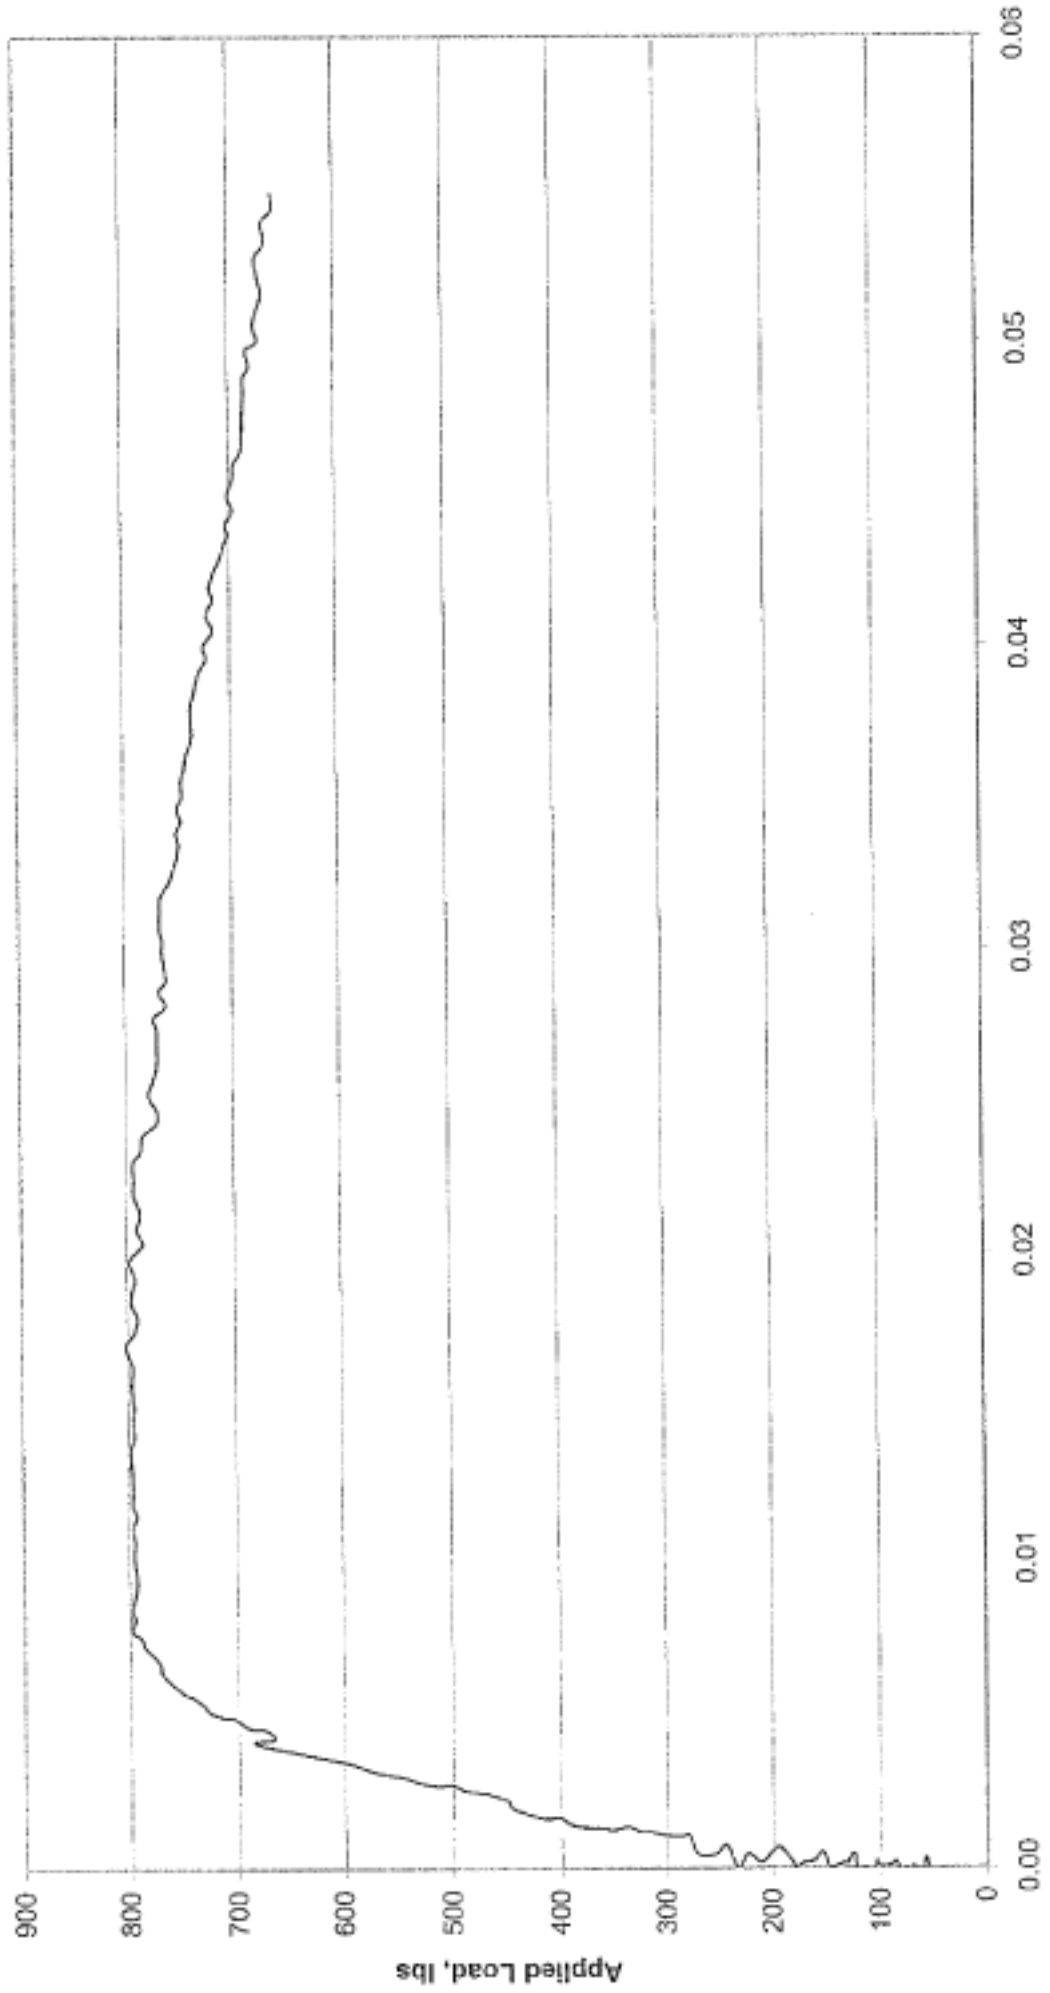Post Crack Deflection vs. Post Crack Load (ASTM:C1399)**Sample 1A (Fibrillated Fiber 4.0 lb/yd3)****TCT Project Number 032059****July 10, 2002****Deflection, in.**

Information and statements in this report are derived from material information and/or specifications furnished by the client and include any expressed or implied warranties as to the fitness of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of the laboratory. The recording of tests, techniques or test results or entries on this document may be purchased as a library under Federal Statutes including Federal Law Title 18, Chapter 47.

662 Cromwell Avenue • St. Paul, MN 55114-1776
(651) 645-3601 • Fax: (651) 659-7348

Post Crack Deflection vs. Post Crack Load (ASTM:C1399)
Sample 1B (Fibrillated Fiber 4.0 lb/yd3)
TCT Project Number 032059
July 10, 2002

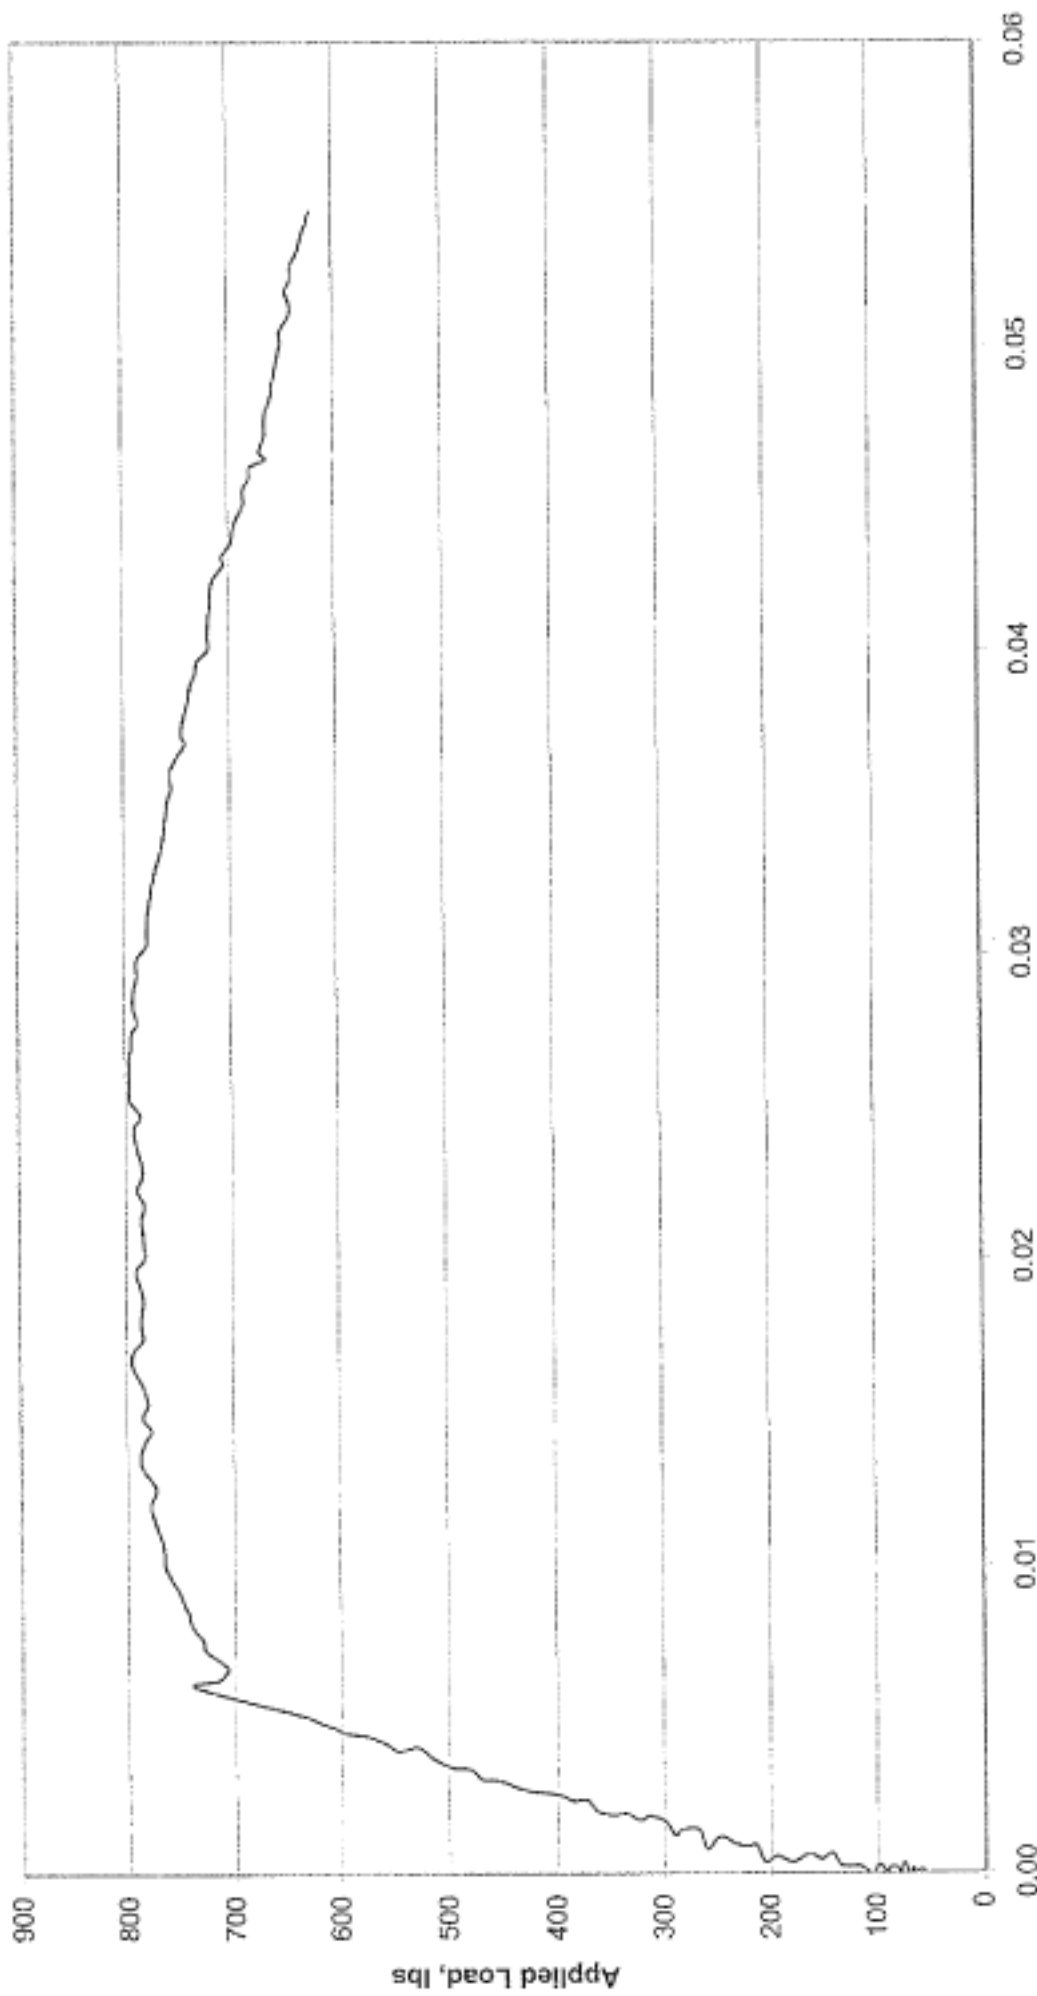

Information and statements in this report are derived from material information and/or specifications furnished by the client and are not warranted as to the accuracy of the material tested or analyzed for any particular purpose or use. This report is the confidential property of our client and may not be used for advertising purposes. The report and/or its contents may be reproduced or otherwise disseminated without the written approval of this laboratory. The recording of data, factious or falsified statements or entries on this document may be punished as a felony under Federal Statutes including Federal Law Title 18, Chapter 47.


662 Cromwell Avenue • St. Paul, MN 55114-1776
(651) 645-3601 • Fax: (651) 659-7348

Post Crack Deflection vs. Post Crack Load (ASTM:C1399)

Sample 1C (Fibrillated Fiber 4.0 lb/yd3)

TCT Project Number 032059

July 10, 2002

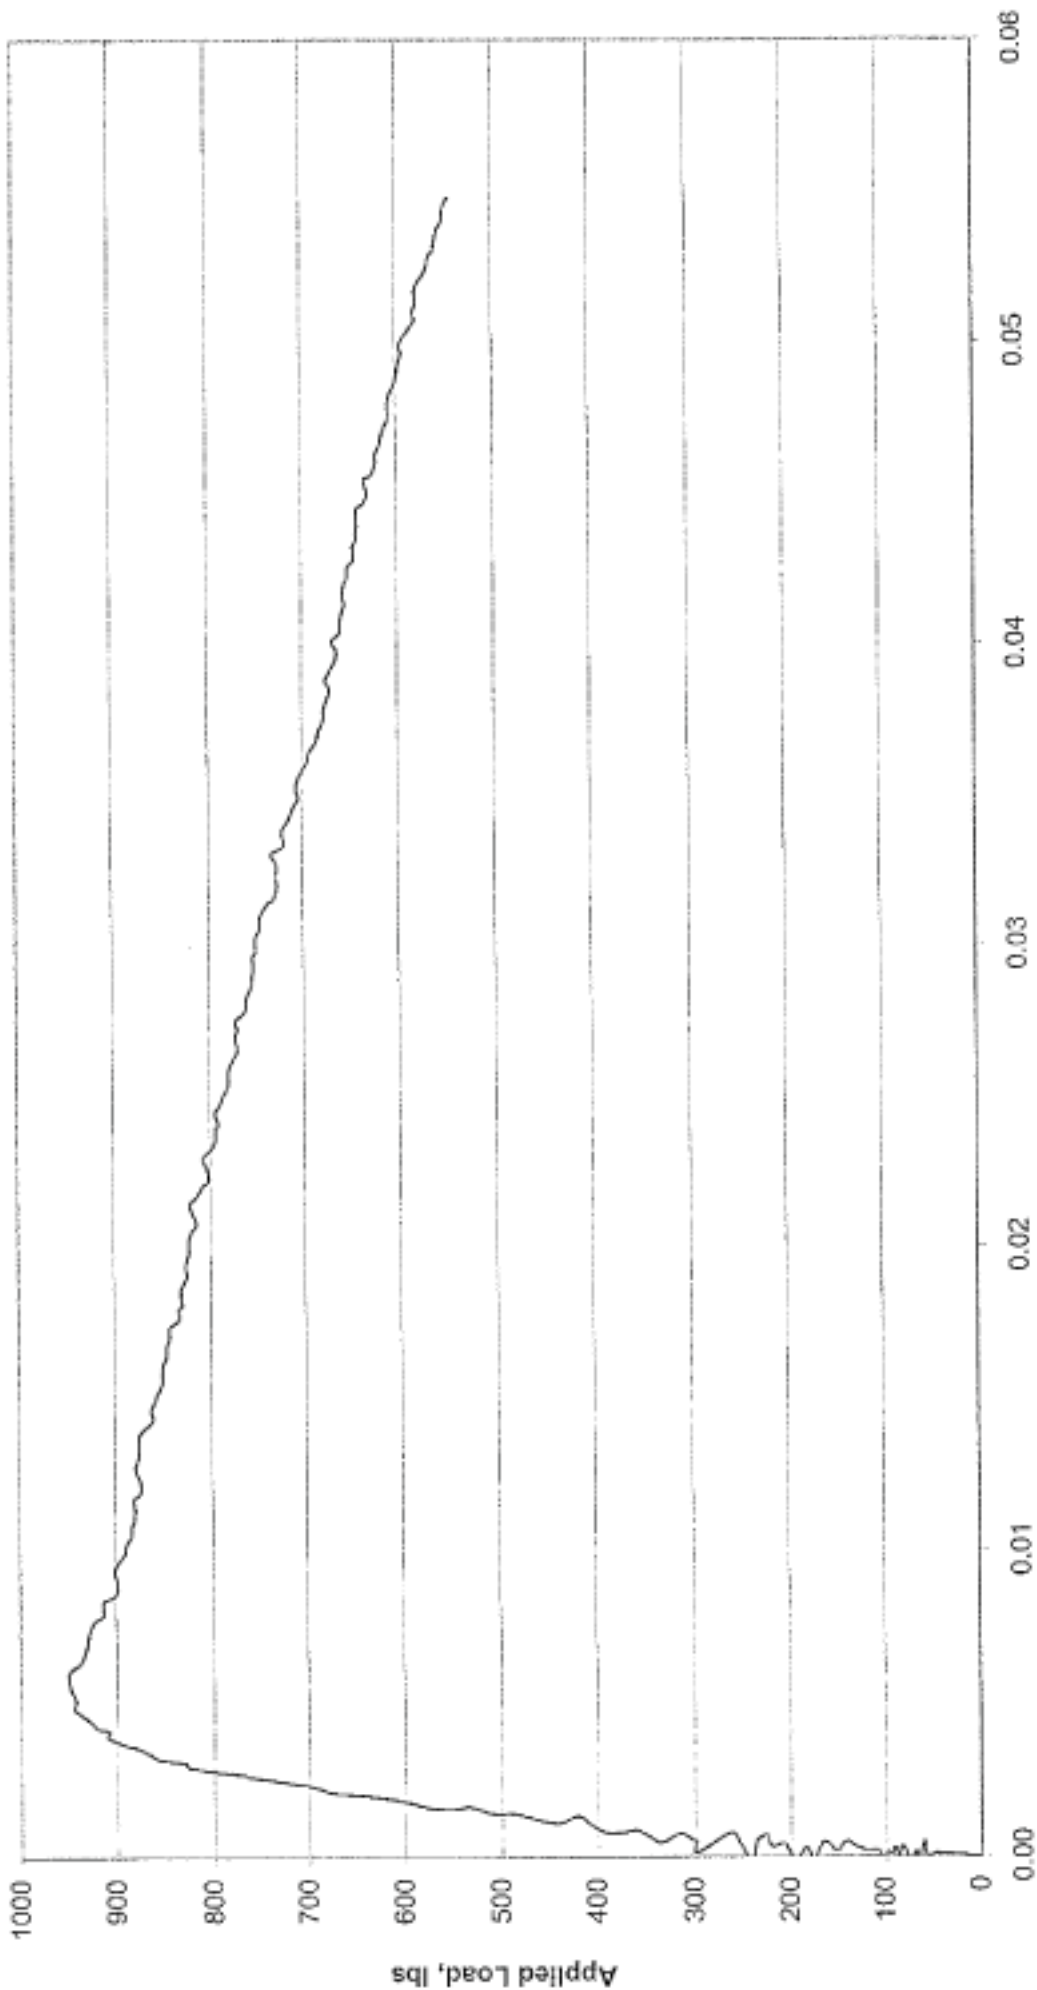

Deflection, in.